



Vendor Fire Safety Brief



Guidance



- **Vendor Safety Guide**
- **<http://www.jber.jb.mil/Services-Resources/Fire-Prevention/>**

- **All food vendors with heat producing equipment will require a fire inspection using the Vendor Fire Safety Checklist**

- **Vendor Fire Safety Checklist will be used as proof of inspection**
 - **Can be found in back of Vendor Safety Guide**



Fire Extinguishers



- **A fire extinguisher is required for each vendor with heat producing equipment**
 - At least 5 lb size with ABC rating
 - At least 10 lb size with BC rating if generator powered
 - Class K for deep fryers
- **Fire extinguishers are the sole responsibility of the vendor**
 - Do not remove from JBER facilities





Fire Safety



■ Generators

- Located 10 feet from cooking operations
- Located 5 feet from neighboring vendors



■ Fuel Storage

- Limited to 5 gallon containers
- Located 10 feet from a heat source
- LP-Gas upright tanks must be secure






Fire Safety



- Outside open flame cooking must be located at least 3 feet from overhead cover

- Exits/exit areas must remain clear

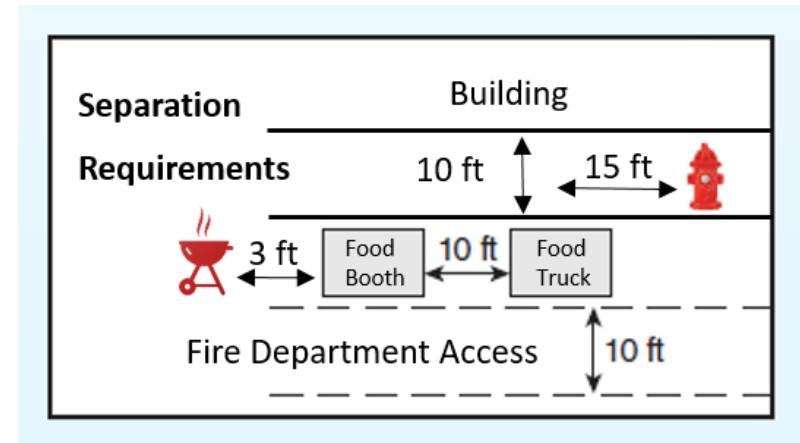

- Access for firefighting vehicles must be maintained
- All fire hydrants must be accessible and have 15 feet of clearance



Fire Reporting



- **All fires must be reported!**
 - No matter how small, even if it has been extinguished
 - Be sure to state you are on JBER





Questions



Fire Prevention

384-5555

Email

673ces.cef.fireprevention@us.af.mil

Public Webpage

<http://www.jber.jb.mil/Services-Resources/Fire-Prevention/>